

# Fire Alarm Bell



LISTED 1124

**Fire Alarm Bell**  
Ø 6", 8"  
ULSZ.S9014  
Audible Signal Appliances  
AIP-624B  
AIP-1024  
AIP-1220

## Features




- Approved
- High dBA Sounds Output.
- Low Power Consumption.
- Available in 6", 8" Housing.
- Quickly and Easily Installed.

## Installation Note

- Remove bell gong by loosening hex bolt.
- Wire bell in circuit.(Notice Polarity)
- Mount bell mechanism on 4" square standard outlet box with the striker facing down.
- Replace the gong and tighten hex bolt.
- The bell must be mounted a minimum of 8ft above the floor, or as close to the ceiling as possible.
- Polarized bell provides Red(+) and Black(-) lead wires. When you install the bell, must observe the polarity.



**Waterproof Back Box**

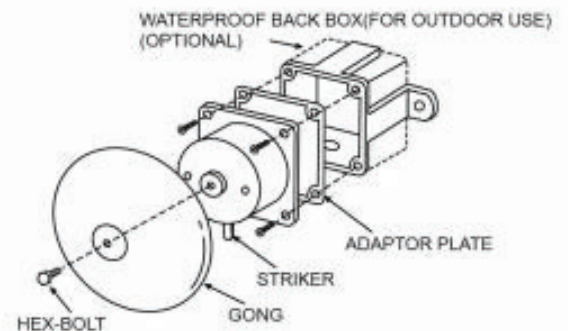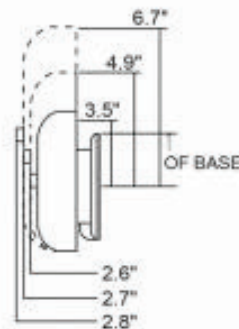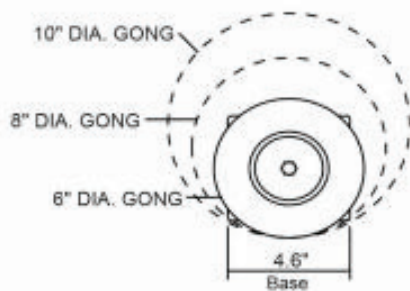

### Motor Driven Type Alarm Bell

Model	Gong Size (Inch)	Rated Voltage	Rated Current	db at 10ft(3m)	Approval
AIP-624B	Ø 6	24V DC	20mA	95	UL

### Coil Driven Type Alarm Bell

Model	Gong Size (Inch)	Rated Voltage	Rated Current	db at 10ft(3m)	Approval
AIP-1024	Ø 8	24V DC	100mA	96	UL
AIP-1220	Ø 6	220V AC	20mA	97	UL